# QB-CF150-D-06

# Plastic pipe penetrating a rigid floor (150mm or thicker)



0mm

0mm 100mm

This standard detail is intended for general information only and all details should be checked against all relevant supporting test evidence, certification and installation guidelines In line with the company's policy of continual development, details are subject to change and/ or withdrawal therefore you must ensure this is the latest published detail and instructions.

### **Additional Instructions**


The floor must have a minimum thickness of 150mm and comprise of concrete, aerated or concrete, with a minimum density of 670kg/m3.

Follow the installation steps referenced in the QuelStop Fire Batt installation guidance document.

### This detail can be installed from the underside only.

Multiple Service Penetrations: The total amount of cross section area of the services (including insulation) should not exceed 60% of the service penetration area.

Page No.

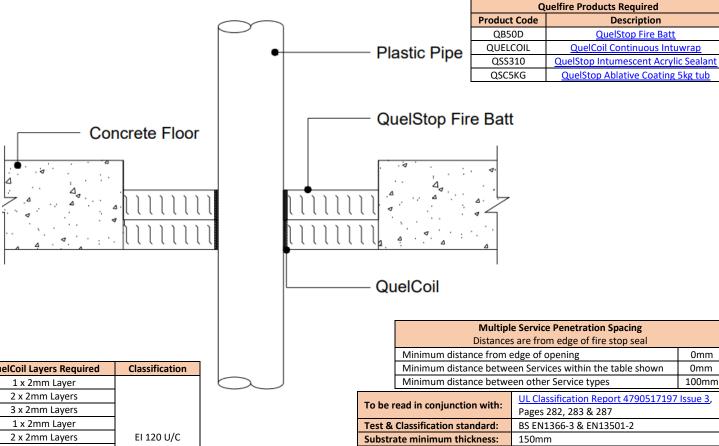

**First Service Support:** 

Maximum Aperture:

**Drawing Scale:** 

Issue Number:

Date of Issue:

**Detail Reference:** 

≤400mm

Not to Scale

June 2025

QB-CF150-D-06

400mm wide x 400mm long

| Service Type                    | Size of Services | Pipe Wall Thickness | QuelCoil Layers Required | Classification |
|---------------------------------|------------------|---------------------|--------------------------|----------------|
| U-PVC                           | ≤Ø50mm           | 2.4mm               | 1 x 2mm Layer            | EI 120 U/C     |
|                                 | Ø51 – Ø75mm      | 2.5 – 4.2mm         | 2 x 2mm Layers           |                |
|                                 | Ø76 – Ø110mm     | 4.2 – 6.6mm         | 3 x 2mm Layers           |                |
| PE, PE-X, ABS,<br>SAN-PVC* Pipe | ≤Ø50mm           | 3.0mm               | 1 x 2mm Layer            |                |
|                                 | Ø51 - Ø75mm      | 3.1 - 5.9mm         | 2 x 2mm Layers           |                |
|                                 | Ø76 - Ø110mm     | 3.4 - 10.0mm        | 3 x 2mm Layers           |                |
| PP                              | ≤Ø50mm           | 2.0mm               | 1 x 2mm Layer            |                |
|                                 | Ø51 - Ø75mm      | 2.1 – 5.3mm         | 2 x 2mm Layers           |                |
|                                 | Ø76 - Ø110mm     | 2.7 - 10.0mm        | 3 x 2mm Layers           |                |
|                                 |                  |                     |                          |                |

\*PE in accordance with EN1519-1. EN1266-1. EN 12201-2 and EN ISO 15494. PE-X in accordance with EN ISO 15875-2, ABS in accordance with EN 1455-1 and EN ISO 15493 as well as SAN+PVC in accordance with ISO 19220

## Important Information:

**Aperture Size** 

400 x 400mm

1100 x 1500mm

- The supporting construction must be installed in accordance with the manufacturer's guidelines and must be capable of achieving the required fire rating of the firestop.
- All Services should be adequately supported on both sides of the firestop to ensure that no load is transferred onto the firestop seal.

#### Scope and Liability:

- Any Information provided by or on behalf of Quelfire Limited is provided for general information only. It is not intended to amount to advice on which you should rely. You must obtain professional or specialist advice before taking, or refraining from, any recommendation or action.
- The summary is not exhaustive and does not consider all issues relevant to the enquiry. It is limited to the information and time available to us. We have not verified any information made available to us by you or any other source, nor have we carried out a physical inspection of any property. We make no representations, warranties or guarantees, whether expressed or implied, that any information is accurate, complete or up to date.
- We do not accept a duty of care to you or any other person in respect of the enquiry, nor do we accept any liability to you or any other person for any loss arising out of or in connection with the enquiry or any reply provided by us. Different limitations and exclusions of liability arising as a result of the supply of any products or services by us to you, and these will be set out in our terms and conditions of supply, a copy of which is available on request.
- Full terms and conditions of sale are available at <a href="https://www.quelfire.co.uk/terms-conditions-of-sale/">https://www.quelfire.co.uk/terms-conditions-of-sale/</a>

# QB-CF150-D-06

# Plastic pipe penetrating a rigid floor (150mm or thicker)

This standard detail is intended for general information only and all details should be checked against all relevant supporting test evidence, certification and installation guidelines In line with the company's policy of continual development, details are subject to change and/ or withdrawal therefore you must ensure this is the latest published detail and instructions.

### **Additional Instructions**

The floor must have a minimum thickness of 150mm and comprise of concrete, aerated or concrete, with a minimum density of 670kg/m3.

Follow the installation steps referenced in the QuelStop Fire Batt installation guidance document.

### This detail can be installed from the underside only.

Multiple Service Penetrations: The total amount of cross section area of the services (including insulation) should not exceed 60% of the service penetration area.

Page No.

Size of Services

≤Ø50mm

Ø51 – Ø75mm

Ø76 - Ø110mm

≤Ø50mm


Ø51 - Ø75mm

Ø76 - Ø110mm

≤Ø50mm

Ø51 - Ø75mm

Ø76 - Ø110mm

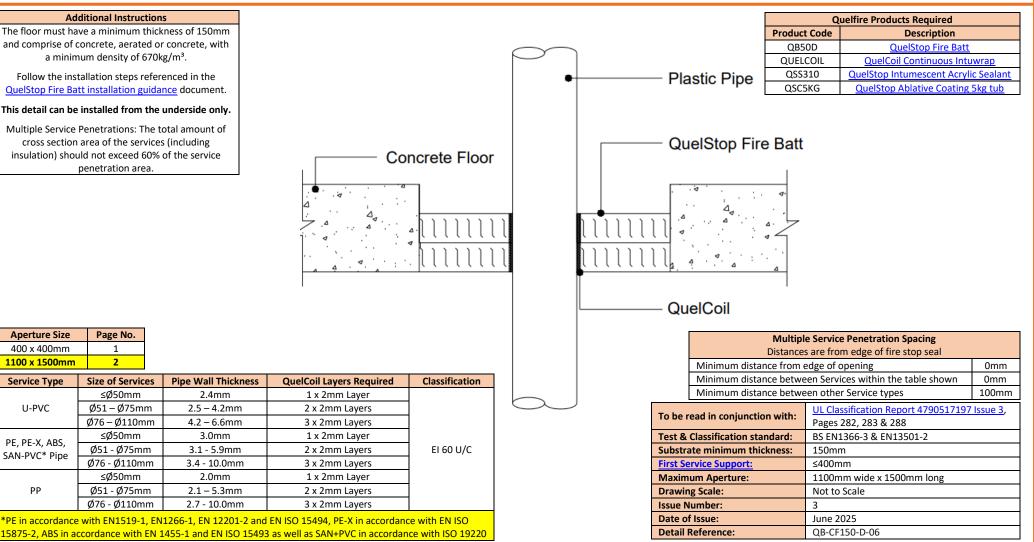

## Important Information:

**Aperture Size** 

400 x 400mm

1100 x 1500mm

Service Type

U-PVC

PE. PE-X. ABS.

SAN-PVC\* Pipe

- The supporting construction must be installed in accordance with the manufacturer's guidelines and must be capable of achieving the required fire rating of the firestop.
- All Services should be adequately supported on both sides of the firestop to ensure that no load is transferred onto the firestop seal.

#### Scope and Liability:

- Any Information provided by or on behalf of Quelfire Limited is provided for general information only. It is not intended to amount to advice on which you should rely. You must obtain professional or specialist advice before taking, or refraining from, any recommendation or action.
- The summary is not exhaustive and does not consider all issues relevant to the enquiry. It is limited to the information and time available to us. We have not verified any information made available to us by you or any other source, nor have we carried out a physical inspection of any property. We make no representations, warranties or guarantees, whether expressed or implied, that any information is accurate, complete or up to date.
- We do not accept a duty of care to you or any other person in respect of the enquiry, nor do we accept any liability to you or any other person for any loss arising out of or in connection with the enquiry or any reply provided by us. Different limitations and exclusions of liability arising as a result of the supply of any products or services by us to you, and these will be set out in our terms and conditions of supply, a copy of which is available on request.
- Full terms and conditions of sale are available at <a href="https://www.quelfire.co.uk/terms-conditions-of-sale/">https://www.quelfire.co.uk/terms-conditions-of-sale/</a>

**Pipe Wall Thickness** 

2.4mm

2.5 - 4.2mm

4.2 - 6.6mm

3.0mm

3.1 - 5.9mm

3.4 - 10.0mm

2.0mm

2.1 - 5.3mm

2.7 - 10.0mm